



**PRODUCT OVERVIEW**  
EXPLOSION PREVENTION



ATEX.

**Measuring technology for applications in Ex areas.**

## Utilising synergies

With the merger of companies, we have expanded our competence considerably and therefore also offer optimal assistance and consultation in all matters relating to measuring, control, and closed-loop control technologies.

We are capable of offering a complete product portfolio for requirements of the broadest range of segments:



Process measurement technology

Laboratory measurement technology

Industrial electronics / closed-loop control technology

Industrial measurement technology

Test stand measurement technology

Customer-specific developments

## Quality from Germany

All products from GHM Messtechnik are developed and produced in Germany. Through the consolidation of companies, the product range has expanded significantly. Renowned companies value the "Quality from Germany".

## Our claim – Your benefit

As a specialist and complete measurement technology provider, we develop solutions tailored to our customers and markets which meet the highest demands in the industry.

### Our locations



**GREISINGER**



**HONSBERG**



**Martens**



**IMTRON**



**DeltaGHM**



**VAL.CO**

## Flexibility and Innovation

These two terms are an inseparable part of the success of GHM Messtechnik.  
In addition to the extensive standard programme, tailored solutions are developed according to customer needs.



Altium 3D circuit board layout



Pressure testing up to 1000 bar



EMC cabins

GHM stands for  Competence

Quality

Service

## Our competences in the Ex area

Our products fulfil the special requirements of the ATEX Directive 2014/34/EU in the fields of:

- Industrial Sensors and Instrumentation
- Industrial Electronics
- Laboratory Instrumentation

and are therefore recommended for use in the Ex area.





**Basics of explosion protection**

Basics. . . . . 6

**Temperature**

GTF 101-Ex . . . . . 12  
 GTF 111-Ex . . . . . 12  
 GTF 102-Ex . . . . . 12  
 GTF 112-Ex . . . . . 12  
 GTF 103-Ex . . . . . 13  
 TC293. . . . . 13  
 TR293. . . . . 13  
 TC296. . . . . 14  
 TR296. . . . . 14  
 GTL720 . . . . . 14  
 MU500Ex . . . . . 15  
 PMT50Ex-2/-3 . . . . . 15  
 TG50Ex . . . . . 15  
 STL50Ex. . . . . 15

**Flow**

A-V1 . . . . . 16  
 A-V2 . . . . . 16  
 A-V3 . . . . . 16  
 A-H1.1 . . . . . 17  
 A-H1.2 . . . . . 17  
 A-H2.1 . . . . . 17  
 A-H3.1 . . . . . 17  
 A-H4.1 . . . . . 18  
 A-H4.2 . . . . . 18  
 A-U1-1 . . . . . 18  
 A-U1-2 . . . . . 18  
 A-H4.1 . . . . . 18  
 A-H4.2 . . . . . 18  
 A-U1-1 . . . . . 18

**Level**

A-U1-2 . . . . . 18

**Pressure**

IL10. . . . . 19  
 IS3 . . . . . 19



---

## Weighing

PC22 . . . . .	.20
SB8 . . . . .	.20
RC3. . . . .	.20
DMS50Ex . . . . .	.20

## Displays

GIA 0420 N-ex. . . . .	.21
GIA 010 N-ex . . . . .	.21
GIA 0420.-ex . . . . .	.21
GIA 0420 WK.-ex . . . . .	.21

## Transmitters

PMT50Ex-1 . . . . .	.21
---------------------	-----

## Isolation Amplifiers

TV500Ex . . . . .	.22
ST500Ex. . . . .	.22
TV501Ex . . . . .	.22
TV125M-Ex . . . . .	.22
TV500Ex . . . . .	.22
ST500Ex. . . . .	.22
TV501Ex . . . . .	.22
TV125M-Ex . . . . .	.22
TS125L-Ex. . . . .	.23
TS125M-Ex . . . . .	.23
TS225M-Ex . . . . .	.23
TS500-Ex . . . . .	.23

## Security and Monitoring Equipment

MR50Ex. . . . .	.23
STL50Ex. . . . .	.23

## Handhelds Instruments and Pressure Sensors

GMH 3111-ex . . . . .	.24
GMH 3151-ex . . . . .	.24
GMH 3156-ex . . . . .	.24
GMSD-ex . . . . .	.25
MSD-ex . . . . .	.25
GMH 3161 -...- ex . . . . .	.25
GMH 3181 -...- ex . . . . .	.25




### Legal Basis of Explosion Protection

Explosion protection is legally regulated throughout the world by the governments of individual states. Country-specific differences in technical requirements and requisite approvals for explosion-protected equipment place high demands on globally-operative companies, in particular, and necessitate high expenditures on development and approvals.

Consequently, there has been an interest among the leading industrial nations to eliminate barriers to trade through harmonisation of the applicable technical standards and at the same time to implement uniform safety standards.

Within the European Union, the harmonisation process in the area of explosion protection is largely completed. At the international level the IEC has the goal of coming closer to a „one test and one certificate worldwide“ accepted by the IECEx Scheme, which currently has only gained very limited acceptance ([www.iecex.com](http://www.iecex.com)).

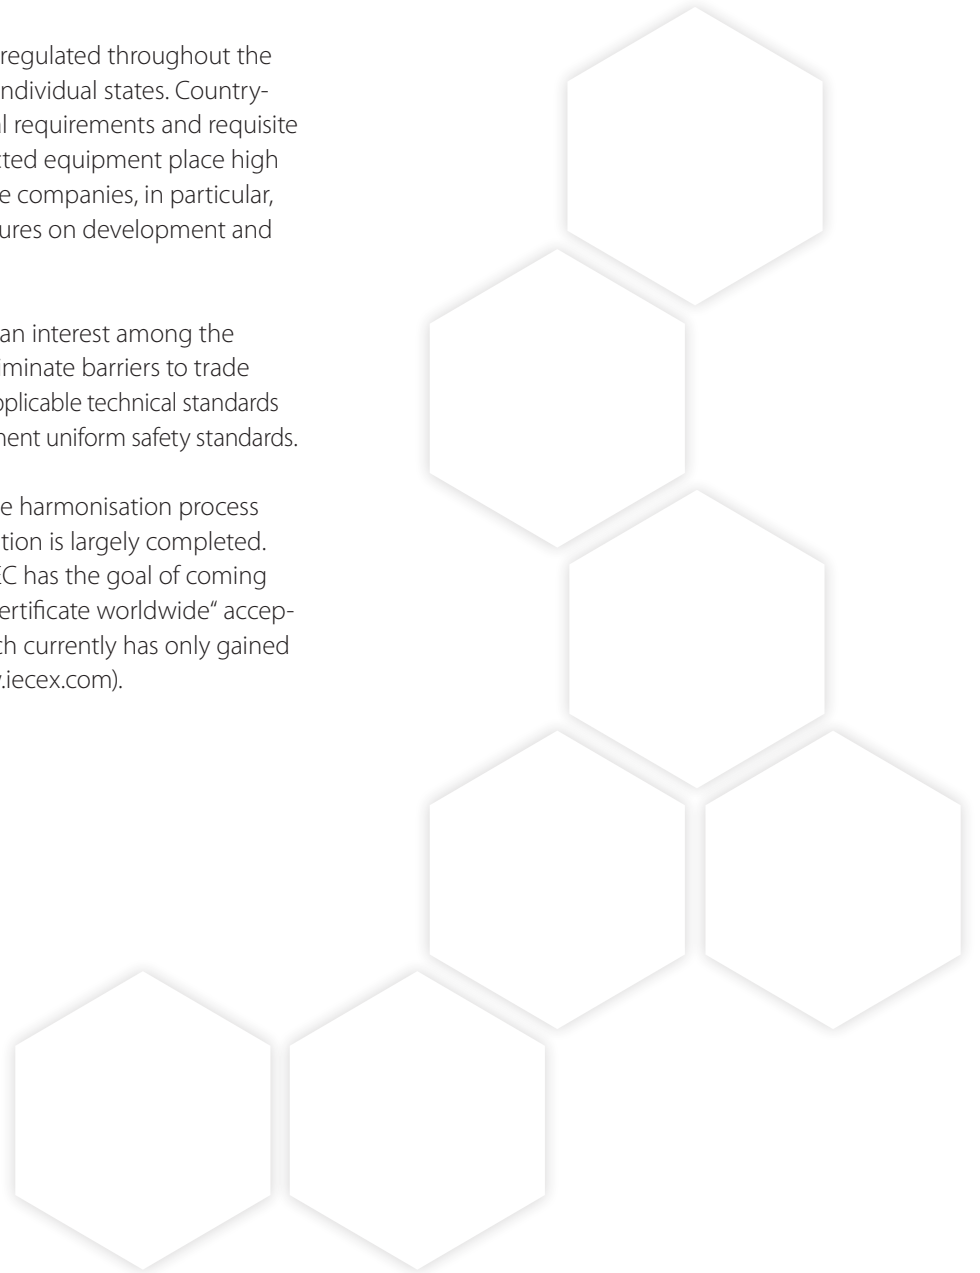

## EU Directives / CE Symbol

Explosion protection is regulated in the European Union by Directives and Laws. Electrical equipment must satisfy the relevant EU regulations. If these requirements are fulfilled, a manufacturer can provide the relevant equipment with the CE symbol. Any misuse in this respect is subject to prosecution.

According to Directive 2014/34/EU (ATEX Directive), this symbol for explosion protection with specific equipment classification – when required – is accompanied by the registered number of the Notified Body (NB) responsible for the recognition of the quality assurance system.




Unlike non-European laws, the ATEX Directives also apply for non-electrical equipment, such as pneumatic drives. Corresponding plants and apparatuses are classified as plants requiring supervision, and only equipment approved for this purpose may be used. In addition, commissioning, modifications and periodic safety inspections must be accepted and/or performed by officially approved institutions or organisations. The EU Directives serve as the legal framework that is bindingly legislated for all EU Member States.

## Explosion

Thus explosions can occur in atmospheric air, three factors may need to come together usually:

- Flammable material
- Oxygen (air)
- Ignition source

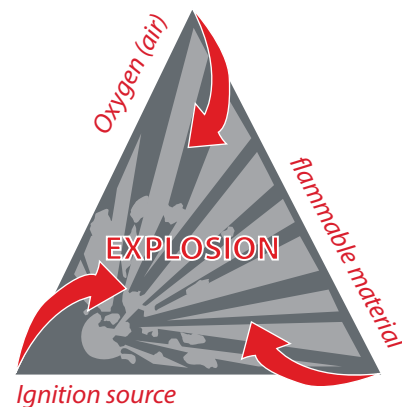



## Ignition sources (according to EN 1127-1)

A multitude of ignition sources is possible in connection with technical apparatuses. Potential ignition sources according to EN 1127-1 include:

- Hot surfaces
- Flames, hot gases and particles
- Mechanically generated sparks
- Electrical Plants
- Electrical compensating currents, cathodic corrosion protection
- Static electricity
- Lightning strikes
- Electromagnetic radiation – RF radiation
- Electromagnetic radiation – IR radiation
- Ionising radiation – UV radiation
- Ultrasound
- Adiabatic compression and shock waves

The most frequent ignition sources are self-ignition, hot surfaces and mechanically generated sparks.

## Equipment Groups / Categories (according to EN 60079-0)

Equipment is divided into three equipment groups. Each equipment group contains apparatuses which are, in turn, assigned to different categories. The category states the zone in which the apparatuses may be used.

Apparatuses of **equipment group I** are used for mining which is at risk of fire damp.

An additional subdivision into explosion groups applies for the electrical apparatuses of **equipment group II**. Electrical apparatuses with the approval for explosion group IIC (gases) may also be used in explosion groups IIA and IIB.

Electrical apparatuses of **equipment group III** (dusts) are also subdivided into additional explosion groups.

## Zones

Areas at risk of explosion are divided into zones. The zone classification depends on the temporal and local probability of the presence of a dangerous, potentially explosive atmosphere. Information and specifications for the zone classification are described in EN 60079-0.

Equipment in areas constantly at risk of explosion (Zone 0/20) are subject to higher requirements, whereas equipment in lower risk areas (Zone 1/21, Zone 2/22) are subject to lower requirements.

## Zoning

Zone 0	Area in which a potentially explosive atmosphere as a mixture of air and flammable gases, vapours or mists is continuously, present over long periods or frequently present.
Zone 1	Area in which a potentially explosive atmosphere as a mixture of air and flammable gases, vapours or mists can occasionally form during normal operation.
Zone 2	Area in which a potentially explosive atmosphere as a mixture of air and flammable gases, vapours or mists normally does not arise or only arises for a short time.
Zone 20	Area in which a potentially explosive atmosphere in the form of a cloud of flammable dust contained in the air is continuously present, present for long periods or is frequently present.
Zone 21	Area in which a potentially explosive atmosphere in the form of a cloud of flammable dust contained in the air can form occasionally during normal operation.
Zone 22	Area in which a potentially explosive atmosphere in the form of a cloud of flammable dust contained in the air normally does not arise or only arises for a short time.



## Ignition Protection Category

The ignition protection categories are design and electrical measures on the equipment to achieve explosion protection in hazardous areas. Protection types are secondary explosion protection measures. The scope of the secondary explosion protection measures depends on the probability for the occurrence of a hazardous explosive atmosphere. Electrical apparatus for potentially explosive areas must conform to the general requirements of the EN 60079-0 and the special requirements for relevant type of protection which they are designed. For GHM products according to EN 60079-0 the below illustrated types of protection are of importance.

### Intrinsic safety „i“ (according to EN 60079-11)

The basis for the „intrinsic safety“ ignition protection class is that a specific minimum ignition energy is required for the ignition of a potentially explosive atmosphere. In intrinsically safe power circuits, no sparks and no heating can occur in the event of an error due to the limitation of current and voltage.

### Flameproof enclosures „d“ (according to EN 60079-1)

Parts that can ignite a potentially explosive atmosphere are arranged in a housing which, in the event of an explosion of a potentially explosive mixture in the interior, withstands the pressure of the explosion and prevents its transfer to the potentially explosive atmosphere surrounding the housing.

### Increased safety „e“ (according to EN 60079-7)

For this ignition protection type a higher degree of safety is provided by measures which reliably prevent the occurrence of impermissibly high temperatures and the occurrence of sparks or electric arc in the interior and on exterior parts of electrical apparatuses on which they do not occur normal operation.

## Equipment Protection Category (EPL)



An alternative method for classification of the Ex equipment into areas at risk of explosion is the system of the Equipment Protection Level (EPL) according to IEC 60079-0.

Equipment Group I (for equipment in subterranean operations of mining as well as their underground plants which can be at risk from mine gas and/or flammable dusts)		
Equipment Protection Level EPL	Ma	Mb
Requirement Protection Level	very high	high
Sufficient safety	in the event of a gas outbreak (if the equipment remains in operation)	in the time span between the gas outbreak and the shut-down of the equipment

Equipment Group II (for equipment in the remaining areas at risk of explosion)						
Equipment Protection Level EPL	Ga	Da	Gb	Db	Gc	Dc
Requirement Protection Level	very high		high		elevated	
Use in	Zone 0	Zone 20	Zone 1	Zone 21	Zone 2	Zone 22

## Sufficient Security

Zone 0 / 20	for specified operation, for expected errors and for rarely occurring
Zone 1 / 21	for specified operation, for expected errors which are not necessarily the normal case
Zone 2 / 22	for specified operation, the ignition occurs at any regular expected events





## Ignition temperatures and temperature classes for gases

The ignition temperature of a flammable gas or a flammable liquid is the lowest temperature of a heated surface on which the ignition of the gas/air or vapour/air mixture occurs. Therefore the highest surface temperature of an apparatus must always be lower than the ignition temperature of the surrounding atmosphere.

The temperature classes T1 to T6 are established for electrical equipment of Explosion Group II. Each temperature class is assigned equipment based on their maximum surface temperature.

Temperature classes	Ignition temperature of mixtures	Permissible surface temperature of equipment
T1	> 450 °C	450 °C
T2	> 300 ... ≤ 450 °C	300 °C
T3	> 200 ... ≤ 300 °C	200 °C
T4	> 135 ... ≤ 200 °C	135 °C
T5	> 100 ... ≤ 135 °C	100 °C
T6	> 85 ... ≤ 100 °C	85 °C

## Ignition temperatures for dusts


For dusts the method of determining the ignition temperature has likewise become uniform and is specified in the document IEC 61241-2-1. It must be noted that dust in the deposited form – as a layer – and in the dispersed form – as a cloud – have different ignition temperatures.

Ignition temperature / dusts	
Permissible temperature from a layer $T_{zul.S} = T_{min.S} - 75 \text{ K}$	Permissible temperature from a layer $T_{zul.W} = 2/3 T_{min}$
Max. permissible surface temperature of the equipment $T_{zul.S} \geq T_{zul} \leq T_{zul.W}$	



## Marking

Example of a marking for electrical explosion-protected equipment with explosion protection according to Directive 94/9/EC and EN 60079-0:

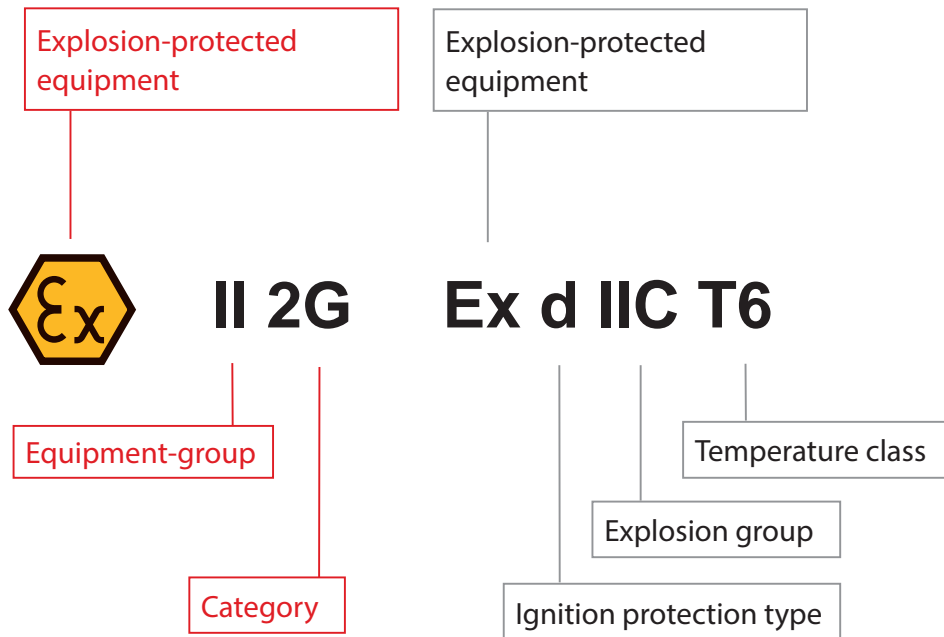

■ Identification according to 94/9/EG

■ General identification according to EN 60079-0





## B Industrial Sensors and Instrumentation

### B1 Temperature



- II 1G Ex ia IIC T6 Ga
- II 1D Ex ia IIIC T80 °C Da IP65
- II 2G Ex ia IIC T6 Gb
- II 2D Ex ia IIIC T80 °C Db IP65
- II 2G Ex e m IIC T6 Gb
- II 2D Ex mb IIIC T80 °C Db IP65



- II 1G Ex ia IIC T6 Ga
- II 1D Ex ia IIIC T80 °C Da IP65
- II 1/2G Ex ia IIC T6 Ga/Gb
- II 1/2D Ex ia IIIC T80 °C Da/Db IP65
- II 2G Ex ia IIC T6 Ga
- II 2D Ex ia IIIC T80 °C Da IP65
- II 2G Ex e m IIC T6 Gb
- II 2D Ex mb IIIC T80 °C Db IP65

Device type	GTF 101-Ex / GTF 111-Ex	GTF 102-Ex / GTF 112-Ex
<b>Brief description</b>	<p><b>Ex temperature sensor without process connection</b>  <b>GTF111-EX: with M12-round plug connector</b></p> <p><b>Measuring element:</b>                      Pt100/Pt1000, jacket thermal element, 4-wire Typ K (NiCr-Ni)</p> <p><b>Measurement range with extension tube:</b>                      -200 °C...+600 °C (for Pt100 / Pt1000)                      -200 °C...+900 °C (for NiCrNi)</p> <p><b>Sensor length:</b>                      up to 1 m (longer on request)</p> <p><b>Sensor diameter:</b>                      3, 4, 5, 6 or 8 mm</p> <p><b>Process connection:</b>                      without thread *</p> <p><b>Ambient temperature:</b>                      -20...+60 °C (+80 °C)                      optional: -20...+80 °C (Ignition protection type „i“)</p>	<p><b>Ex temperature sensor with process connection</b>  <b>GTF112-EX: with M12-round plug connector</b></p> <p><b>Measuring element:</b>                      Pt100/Pt1000, jacket thermal element, 4-wire Typ K (NiCr-Ni)</p> <p><b>Measurement range with extension tube:</b>                      -200 °C...+600 °C (for Pt100 / Pt1000)                      -200 °C...+900 °C (for NiCrNi)</p> <p><b>Sensor length:</b>                      up to 1 m (longer on request)</p> <p><b>Sensor diameter:</b>                      3, 4, 5, 6 or 8 mm</p> <p><b>Process connection:</b>                      with thread:                      • G 1/2" (standard)                      • optional: G 1/8", G 1/4", G 3/8", G 3/4", M10x1, M12x1,5, M14x1,5, M16x1,5, M18x1,5, other on request</p> <p><b>Ambient temperature:</b>                      -20...+60 °C (+80 °C)                      optional: -20...+80 °C (Ignition protection type „i“)</p>
<b>Ignition protection type</b>	Intrinsic safety „i“ Elevated safety „e“	Intrinsic safety „i“ Elevated safety „e“
<b>Protection class</b>	IP 65	IP 65
<b>Equipment group</b>	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II
<b>Potentially explosive area</b>	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 0, Zone 1/2, Zone 1, Zone 2, Zone 20, Zone 20/21, Zone 21, Zone 22

\* We recommend using a compression fitting



II 1G Ex ia IIC T6 Ga  
 II 1D Ex ia IIIC T80 °C Da IP65  
 II 1/2G Ex ia IIC T6 Ga/Gb  
 II 1/2D Ex ia IIIC T80 °C Da/Db IP65  
 II 2G Ex ia IIC T6 Ga  
 II 2D Ex ia IIIC T80 °C Da IP65  
 II 2G Ex e m IIC T6 Gb  
 II 2D Ex mb IIIC T80 °C Db IP65



Ex II 1G Ex ia IIC T1...T6  
 Ex II 1D / Ex tD A 1D IP6X T80°C



Ex II 1G Ex ia IIC T1...T6  
 Ex II 1D / Ex tD A 1D IP6X T80°C

GTF 103-Ex	TC293-Ex	TR293-Ex
<p><b>Ex temperature sensor with process connection and sensor head</b></p> <p><b>Measuring element:</b> Pt100/Pt1000, jacket thermal element, 4-wire Typ K (NiCr-Ni)</p> <p><b>Measurement range with extension tube:</b> -200 °C...+600 °C (for Pt100 / Pt1000) -200 °C...+900 °C (for NiCrNi)</p> <p><b>Sensor length:</b> up to 1 m (longer on request)</p> <p><b>Sensor diameter:</b> 3 mm , 4, 5, 6 or 8 mm</p> <p><b>Process Connection:</b> a) without thread * b) with thread: • G 1/2" (standard) • optional: G 1/8", G 1/4", G 3/8", G 3/4", M10x1, M12x1,5, M14x1,5, M16x1,5, M18x1,5, other on request</p> <p><b>Ambient temperature</b> -20...+60 °C (+80 °C) optional: -20...+80 °C (Ignition protection type „i“)</p>	<p><b>Safety thermocouple for gaseous media</b></p> <p><b>Measuring element:</b> Typ J (Fe-CuNi) Typ K (NiCr-Ni) Typ N (NiCrSi-NiSi)</p> <p><b>Protective tube diameter:</b> 9 auf 3 mm tapered</p> <p><b>Nominal length:</b> 100, 160, 250, 400, 600 mm</p> <p><b>Process Connection:</b> compression fitting G1/2B</p> <p><b>Working temperature</b> <b>Typ J (Fe-CuNi)</b> -100...+600 °C <b>Typ K (NiCr-Ni)</b> -100...+900 °C <b>Typ N (NiCrSi-NiSi)</b> -100...+1000 °C</p> <p><b>Ambient temperature:</b> -40...+100°C (Gas) -20...+80°C (Dust)</p> <p>approved to be used as transducers to DIN EN 14597 for exhaust gas and air</p>	<p><b>Safety temperature sensor for gaseous media</b></p> <p><b>Measuring element:</b> Pt100</p> <p><b>Protective tube diameter:</b> 9 auf 3 mm tapered</p> <p><b>Nominal length:</b> 100, 160, 250, 400, 600 mm</p> <p><b>Process Connection:</b> compression fitting G1/2B</p> <p><b>Working temperature:</b> -100... +600°C</p> <p><b>Ambient temperature:</b> -40...+100°C (Gas) -20...+80°C (Dust)</p> <p>approved to be used as transducers to DIN EN 14597 for exhaust gas and air</p>
Intrinsic safety „i“ Elevated safety „e“	Intrinsic safety „i“	Intrinsic safety „i“
IP 65	IP 65	IP 65
Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II
Zone 0, Zone 1/2, Zone 1, Zone 2, Zone 20, Zone 20/21, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2	Zone 0, Zone 1, Zone 2

More information can be found in the product information **Temperature** online on [www.ghm-messtechnik.de](http://www.ghm-messtechnik.de)

\* We recommend using a compression fitting



## B Industrial Sensors and Instrumentation

### B1 Temperature



Ex II 1G Ex ia IIC T1...T6  
Ex II 1D / Ex tD A 1D IP6X T80°C



Ex II 1G Ex ia IIC T1...T6  
Ex II 1D / Ex tD A 1D IP6X T80°C



Ex II 2G Ex ia IIB T3/T4/T5 Ex II 2G  
Ex ib IIB T3/T4/T5

Device type	TC296-Ex	TR296-Ex	GTL720
<b>Brief description</b>	<p><b>Safety thermocouple for liquid media and air</b></p> <p><b>Measuring element:</b> Typ J (Fe-CuNi) Typ K (NiCr-Ni) Typ N (NiCrSi-NiSi) <b>Protective tube diameter:</b> 9 auf 6 mm tapered <b>Nominal length:</b> 100, 160, 250, 400, 600 mm <b>Process Connection:</b> Thread G1/2B <b>Working temperature:</b> <b>Typ J (Fe-CuNi)</b> -100...+600 °C <b>Typ K (NiCr-Ni)</b> -100...+900 °C <b>Typ N (NiCrSi-NiSi)</b> -100...+1000 °C <b>Ambient temperature:</b> -40...+100 °C (Gas) -20...+80 °C (Dust)</p> <p>approved to be used as transducers to DIN EN 14597 for water, oil and air</p>	<p><b>Safety temperature sensor for liquid media and air</b></p> <p><b>Measuring element:</b> Pt100 <b>Protective tube diameter:</b> 9 auf 6 mm tapered <b>Nominal length:</b> 100, 160, 250, 400, 600 mm <b>Process Connection:</b> Thread G1/2B <b>Working temperature:</b> -100...+600 °C <b>Ambient temperature:</b> -40...+100 °C (Gas) -20...+80 °C (Dust)</p> <p>approved to be used as transducers to DIN EN 14597 for water, oil and air</p>	<p><b>Clamp-on temperature sensor</b></p> <p><b>Measuring element:</b> Pt100, Klasse A <b>Pipe diameter:</b> DN10...DN80 <b>Electrical connection:</b> 4 pole M12x1 <b>Measuring range:</b> -20...+160 °C <b>Ambient temperature</b> -20...+85°C</p>
<b>Ignition protection type</b>	Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“
<b>Protection class</b>	IP 65	IP 65	IP 67
<b>Equipment group</b>	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II	Gas mixtures of Equipment group II
<b>Potentially explosive area</b>	Zone 0, Zone 1, Zone 2	Zone 0, Zone 1, Zone 2	Zone 1, Zone 2



**PROFIBUS**



Ex II (1) G [Ex ia] IIC  
Ex II (1) D [Ex iaD]

Ex II (1) G [Ex ia] IIC/IIB  
Ex II (1) D [Ex iaD]

Ex II (1) G [Ex ia] IIC/IIB  
Ex II (1) D [Ex iaD]

Ex II (1) G [Ex ia] IIC/IIB  
Ex II (1) D [Ex iaD]

**MU500-Ex**

**PMT50-Ex-2/-3**

**TG50-Ex**

**STL50-Ex**

**Transducer**

**Transducer**

**Temperature monitor**

**Safety temperature limiter according to DIN EN 14597**

**Measurement input:**  
Pt100, switchable  
to 13 measurement ranges  
Pt1000, switchable  
to 16 measurement ranges  
**Auxiliary voltage:**  
85..253 V AC/110..125 V DC  
10..30 V AC/DC  
**Working temperature:**  
-10..+60 °C

**PMT50Ex-2**  
**Measurement input:**  
Resistance  
measurement 0..20 kΩ,  
Potentiometer measurement  
1..100 kΩ  
**PMT50Ex-3**  
**Measurement input:**  
Pt100, Pt1000 and  
thermocouples J, K, N and S  
Pt100, 3-wire, -100,0..+600,0 °C  
Pt1000, 3-wire, -100,0..+300,0 °C  
**Typ J (Fe-CuNi)** -100,0..+800,0 °C  
**Typ K (NiCr-Ni)** -150..+1200 °C  
**Typ N (NiCrSi-NiSi)** -150..+1200 °C  
**Typ S (Pt10Rh-Pt)** -50..+1600 °C  
**Output:**  
0/4 ..20 mA, 0/2 ..10 V DC  
galvanically isolated,  
max. 2 alarm outputs  
Modbus, Profibus DP

**Measurement input:**  
Pt100, Pt1000 and  
thermocouples J, K, N and S  
Pt100, 3-wire, -100,0..+600,0 °C  
Pt1000, 3-wire, -100,0..+300,0 °C  
**Typ J (Fe-CuNi)** -100,0..+800,0 °C  
**Typ K (NiCr-Ni)** -150..+1200 °C  
**Typ N (NiCrSi-NiSi)** -150..+1200 °C  
**Typ S (Pt10Rh-Pt)** -50..+1600 °C  
**Output:**  
0/4 ..20 mA, 0/2 ..10 V DC  
galvanically isolated  
2 alarm outputs

**Measurement input:**  
PT100, 3-wire, -100 .. +600 °C  
**Typ J (Fe-CuNi)** -100 .. +800 °C  
**Typ K (NiCr-Ni)** -150 .. +1200 °C  
**Typ N (NiCrSi-NiSi)** -150 .. +1200 °C  
**Typ S (Pt10Rh-Pt)** 0 .. 1600 °C  
**Auxiliary voltage:**  
230 V AC +/-10 %  
115 V AC +/-10 %  
24 V DC +/-15 %  
**Working temperature:**  
-10 .. 55 °C

Intrinsic safety „i“

Intrinsic safety „i“

Intrinsic safety „i“

Intrinsic safety „i“

Housing IP 30, optionally IP 20

Housing IP 30, optionally IP 20

Housing IP 30, optionally IP 20

IP 20

Gas or dust mixtures of  
Equipment group II

Gas or dust mixtures of  
Equipment group II

Gas or dust mixtures of  
Equipment group II

Gas or dust mixtures of  
Equipment group II

for connection of sensors from  
Zones 0, 1, 2, 20, 21, 22

for connection of sensors from  
Zones 0, 1, 2, 20, 21, 22

for connection of sensors from  
Zones 0, 1, 2, 20, 21, 22

for connection of sensors from  
Zones 0, 1, 2, 20, 21, 22


More information can be found in the product information **Temperature** or online on [www.ghm-messtechnik.de](http://www.ghm-messtechnik.de)



**B Industrial Sensors and Instrumentation**  
**B2 Flow**



I M1 Ex ia I Ma  
II 1G Ex ia IIC T4 Ga  
II 1D Ex ia IIIC T135°C Da

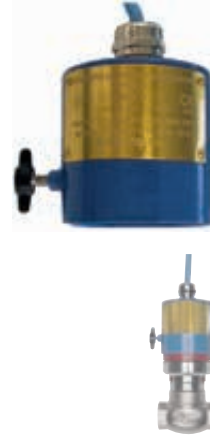

I M1 Ex ia I Ma  
II 1G Ex ia IIC T4 Ga  
II 1D Ex ia IIIC T135°C Da







II 2G Ex d IIC T6

Device type	A-V1	A-V2	A-V3
<b>Brief description</b>	<p><b>ATEX switching head with reedswitch</b></p> <p><b>Use in combination with Flow Switch in Valve Design</b> Type VD-</p> <p><b>Switch:</b> <b>reedswitch</b></p> <p><b>Switching voltage:</b> max. 30 V (without signal diode) max. 15, 28 or 36 V (with signal diode)</p> <p><b>Switching current:</b> max. 1,5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>	<p><b>ATEX switching head with microswitch</b></p> <p><b>Use in combination with Flow Switch in Valve Design-</b> Type VM-</p> <p><b>Switch:</b> microswitch</p> <p><b>Switching voltage:</b> max. 30 V (without signal diode) max. 15, 28 oder 36 V (with signal diode)</p> <p><b>Switching current:</b> max. 1,5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>	<p><b>ATEX switching head with microswitch</b></p> <p><b>Use in combination with Flow Switch in Valve Design-</b> Type VM-</p> <p><b>Switch:</b> microswitch</p> <p><b>Switching voltage:</b> max. 250 V AC</p> <p><b>Switching current:</b> max. 5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>
<b>Ignition protection type</b>	DIN EN 60079-11 Intrinsic safety „i“	DIN EN 60079-11 Intrinsic safety „i“	DIN EN 60079-1 flameproof enclosure „d“
<b>Protection class</b>	IP 65	IP 65	IP 65
<b>Equipment group</b>	Gas or dust mixtures of Equipment group I, II and III	Gas or dust mixtures of Equipment group I, II and III	Gas or dust mixtures of Equipment group II
<b>Potentially explosive area</b>	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 1, Zone 2





			
<p>I M1 Ex ia I Ma II 1G Ex ia IIC T4 Ga II 1D Ex ia IIIC T135°C Da</p>	<p>I M1 Ex ia I Ma II 1G Ex ia IIC T4 Ga II 1D Ex ia IIIC T135°C Da</p>	<p>I M1 Ex ia I Ma II 1G Ex ia IIC T4 Ga II 1D Ex ia IIIB T135°C Da</p>	<p>I M1 Ex ia I Ma</p>
<p><b>A-H1.1</b></p>	<p><b>A-H1.2</b></p>	<p><b>A-H2.1</b></p>	<p><b>A-H3.1</b></p>
<p><b>ATEX switching head with reed switch</b></p> <p><b>Use in combination with Flow Switch in Inline Design</b> Type (n) HD1K-, HD2K-, HD1KO-, HD2KO-</p> <p><b>Switch:</b> reed switch</p> <p><b>Switching voltage:</b> max. 30 V (without signal diode) max. 15, 28, 36 V (with signal diode)</p> <p><b>Switching current:</b> max. 1,5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>	<p><b>ATEX switching head with reed switch</b></p> <p><b>Use in combination with Flow Switch in Inline Design</b> Type (n) HR1MV-, HR1MVO</p> <p><b>Switch:</b> reed switch</p> <p><b>Switching voltage:</b> max. 30 V (without signal diode) max. 15, 28, 36 V (with signal diode)</p> <p><b>Switching current:</b> max. 1,5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>	<p><b>ATEX switching head with reed switch</b></p> <p><b>Use in combination with Flow Switch in Inline Design:</b> Type (n) HD1K-, HD2K-, HD1KO-, HD2KO-</p> <p><b>Switch:</b> reed switch</p> <p><b>Switching voltage:</b> max. 30 V</p> <p><b>Switching current:</b> max. 1,5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>	<p><b>ATEX switching head with reed switch</b></p> <p><b>Use in combination with Flow Switch in Inline Design:</b> Type (n) HD1K-, HD2K-, HD1KO-, HD2KO-</p> <p><b>Switch:</b> reed switch</p> <p><b>Switching voltage:</b> max. 24 V</p> <p><b>Switching current:</b> max. 1,5 A</p> <p><b>Ambient temperature:</b> -20..+50 °C</p>
<p>DIN EN 60079-11 Intrinsic safety „i“</p>	<p>DIN EN 60079-11 Intrinsic safety „i“</p>	<p>DIN EN 60079-11 Intrinsic safety „i“</p>	<p>DIN EN 60079-11 Intrinsic safety „i“</p>
<p>IP 65</p>	<p>IP 65</p>	<p>IP 65</p>	<p>IP 65</p>
<p>Gas or dust mixtures of Equipment group I, II and III</p>	<p>Gas or dust mixtures of Equipment group I, II and III</p>	<p>Gas or dust mixtures of Equipment group I, II and III</p>	<p>Gas or dust mixtures of Equipment group I</p>
<p>Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22</p>	<p>Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22</p>	<p>Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22</p>	<p>Only mines susceptible to firedamp</p>

More information can be found in the product information **Piston Valve Design, Piston Inline Design and Paddle** or online on [www.ghm-messtechnik.de](http://www.ghm-messtechnik.de)




**B Industrial Sensors and Instrumentation**  
**B2 Flow | B3 Level**



I M1 Ex ia I Ma  
 II 1G Ex ia IIC T4 Ga  
 II 1D Ex ia IIIC T135°C Da



I M1 Ex ia I Ma  
 II 1G Ex ia IIC T4 Ga  
 II 1D Ex ia IIIC T135°C Da

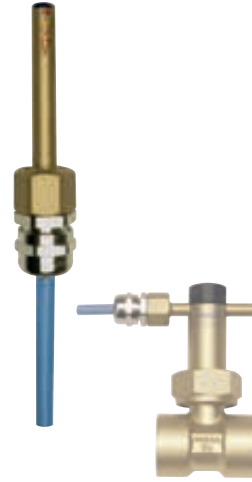

I M1 Ex ia I Ma  
 II 1G Ex ia IIC T4 Ga  
 II 1D Ex ia IIIC T135°C Da



I M1 Ex ia I Ma  
 II 1G Ex ia IIC T4 Ga  
 II 1D Ex ia IIIC T135°C Da

A-H4.1	A-H4.2	A-U1-1	A-U1-2
<p><b>ATEX switch head made of conductive plastic material with reed switch</b></p> <p><b>Use in combination with Flow Switch in Inline Design:</b>                      Type (n) HD1K-, HD2K-, HR2-, HD1KO-, HD2KO-, HR2O-</p> <p><b>Switch:</b>                      Reed switch</p> <p><b>Switching voltage:</b>                      max. 30 V</p> <p><b>Switching current:</b>                      max. 1,5 A</p> <p><b>Ambient temperature:</b>                      -20..+50 °C</p>	<p><b>ATEX switch head made of conductive plastic material with reed switch</b></p> <p><b>Use in combination with Flow Switch in Inline Design:</b>                      Type (n) HD1K-, HD2K-, HR2-, HD1KO-, HD2KO-, HR2O-</p> <p><b>Switch:</b>                      Reed switch</p> <p><b>Switching voltage:</b>                      max. 30 V</p> <p><b>Switching current:</b>                      max. 1,5 A</p> <p><b>Ambient temperature:</b>                      -20..+50 °C</p>	<p><b>ATEX Switching head with reed switch</b></p> <p><b>Use in combination with Flow Switch in Paddle Design:</b>                      Type UR1-</p> <p><b>Switch:</b>                      Reed switch</p> <p><b>Switching voltage:</b>                      max. 30 V</p> <p><b>Switching current:</b>                      max. 1 A</p> <p><b>Ambient temperature:</b>                      -20..+50 °C</p>	<p><b>ATEX Switching head with reed switch</b></p> <p><b>Use in combination with Level Switches:</b>                      Type NW1-</p> <p><b>Switch:</b>                      Reed switch</p> <p><b>Switching voltage:</b>                      max. 30 V</p> <p><b>Switching current:</b>                      max. 1 A</p> <p><b>Ambient temperature:</b>                      -20..+50 °C</p>
DIN EN 60079-11 Intrinsic safety „i“	DIN EN 60079-11 Intrinsic safety „i“	DIN EN 60079-11 Intrinsic safety „i“	DIN EN 60079-11 Intrinsic safety „i“
IP 65	IP 65	IP 65	IP 65
Gas or dust mixtures of Equipment group I, II and III	Gas or dust mixtures of Equipment group I, II and III	Gas or dust mixtures of Equipment group I, II and III	Gas or dust mixtures of Equipment group I, II and III
Zone 0, Zone 1, Zone 2 Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2 Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22



Ex II 1 G Ex ia IIA/IIC T4/T5/T6  
Ex II 1 D Ex iaD T80°C



II 1/2G Ex ia IIC T4/T5/T6 Ga/Gb

Device type	IL10	IS-3
<b>Brief description</b>	<p><b>Fill level sensor (submersible probe)</b></p> <p><b>Measurement range:</b> 0,1..25 bar</p> <p><b>Ambient temperature:</b> -10..+60 °C</p> <p><b>max. immersion depth:</b> 300 m</p>	<p><b>Screw-in sensor</b></p> <p><b>Process connection:</b> Thread G1/2B</p> <p><b>Measurement range:</b> -1..0; 0..1000 bar</p> <p><b>Medium temperature:</b> -20..+80 °C (-20..150°C option)</p> <p><b>Material;</b> stainless steel</p> <p><b>Ambient temperature:</b> -20..+80 °C</p>
<b>Ignition protection type</b>	Intrinsic safety „i“	Intrinsic safety „i“
<b>Protection class</b>	IP 68	IP 65
<b>Equipment group</b>	Gas or dust mixtures of Equipment group II	Gas mixtures of Equipment group II
<b>Potentially explosive area</b>	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2



**B Industrial Sensors and Instrumentation**  
**B7 Weighing**



Ex II 1 G EEx ia IIC T6...T4 T130 °C / T150 °C  
Ex II 1 D EEx ia IIC T6...T4 T130 °C / T150 °C



Ex II 1 G EEx ia IIC T6... T4 T130 °C / T150 °C  
Ex II 1 D EEx ia IIC T6... T4 T130 °C / T150 °C



Ex II 1 G EEx ia IIC T6... T4 T130 °C / T150 °C  
Ex II 1 D EEx ia IIC T6... T4 T130 °C / T150 °C



**PROFIBUS**

Ex II (1) G [Ex ia] IIC/IIB  
Ex II (1) D [Ex iaD]

PC22	SB8	RC3	DMS50Ex
<b>DMS-load-cell</b>	<b>DMS-load-cell</b>	<b>DMS-load-cell</b>	<b>Transducer</b>
<b>Design:</b> Pressure force <b>Measurement range:</b> 5..40 kg <b>Output:</b> 2 mV/V 400 Ω bridge resistance	<b>Design:</b> Pressure force <b>Measurement range:</b> 10..500 kg <b>Output:</b> 2 mV/V 375 Ω bridge resistance	<b>Design:</b> Pressure force <b>Measurement range:</b> 75..100 t <b>Output:</b> 2 mV/V 1150 Ω bridge resistance	<b>Measurement Input:</b> DMS-load-cell Sensitivity: 0,500..5,000 mV/V Bridge Excitation: 2,5V / 5V max. 40 mA <b>Output:</b> Analogue output 0/4..20 mA, 0/2..10 V max. 2 alarm outputs Modbus, Profibus DP
Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“
IP 67	IP 68	IP 68	Housing IP 30, optionally IP 20
Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II
Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	Zone 0, Zone 1, Zone 2, Zone 20, Zone 21, Zone 22	for connection of sensors from Zones 0, 1, 2, 20, 21, 22

More information can be found in the product information or online on [www.ghm-messtechnik.de](http://www.ghm-messtechnik.de)



II 2G Ex ia/ib IIC/IIB T4



II 2G Ex ia/ib IIC/IIB T4



PROFIBUS

Ex II (1) G [Ex ia] IIC/IIB  
Ex II (1) D [Ex iaD]

Device type	GIA 0420 N - ex GIA 010 N - ex	GIA 0420 VO.. - ex, GIA 0420 WK.. - ex	PMT50Ex-1
<b>Brief description</b>	<p><i>Self-sustaining display or display</i></p> <p><b>Input signal (GIA 0420 N - ex):</b> 4..20 mA, 2-wire</p> <p><b>Input signal (GIA 010 N - ex):</b> 0..10 V, 3-wire</p> <p><b>Switching output:</b> galv. isolated open collector switching output</p> <p><b>Working temperature:</b> -20..+50 °C</p> <p><b>Display:</b> 10 mm high LCD display</p> <p><b>Display area:</b> -1999 up to +9999</p>	<p><i>Self-sustaining display for 4 – 20 mA transducer or display</i></p> <p><b>Input signal (GIA 0420 VO.. - ex, GIA 0420 WK.. - ex):</b> 4..20 mA (2-wire)</p> <p><b>Input signal (GIA 010 VO.. - ex, GIA 010 WK.. - ex):</b> 0..10 V (3-wire)</p> <p><b>Switching output optional:</b> galv. isolated open collector switching output</p> <p><b>Working temperature:</b> -20..+50 °C</p> <p><b>Display:</b> 10 mm high LCD display</p> <p><b>Display area:</b> -1999 up to +9999</p>	<p><i>Standard signal transducer</i></p> <p><b>Measurement input:</b> Standard signals 0/4..20 mA; 0/2..10 V</p> <p><b>Output:</b> 0/4..20 mA, 0/2..10 V DC galvanically isolated max. 2 alarm outputs Modbus, Profibus DP</p>
<b>Ignition protection type</b>	Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“
<b>Protection class</b>	IP 54 (optional IP 65) for installation of the housing flush at the front IP 20 for device incl. terminals	IP65 (with properly mounted angle plug) IP65 (IP00 for open cable ends of the termination cable)	Housing IP 30, optionally IP 20
<b>Equipment group</b>	Gas mixtures of Equipment group II	Gas mixtures of Equipment group II	Gas mixtures of Equipment group II
<b>Potentially explosive area</b>	Zone 1, Zone 2	Zone 1, Zone 2	for connection of sensors from Zones 0, 1, 2, 20, 21, 22



**E Industrial Electronics**

**E3 Isolation Amplifiers | E4 Security and Monitoring Equipment**



Ex II (1) G [Ex ia] IIC  
Ex II (1) D [Ex iaD]



Ex II (1) G [Ex ia] IIC  
Ex II (1) D [Ex iaD]



Ex II (1) G [Ex ia Ga] IIC/IIB  
Ex II (1) D [Ex ia Da] IIIC  
Ex II 3 G nA nC [ic] IIB T4 Gc  
Ex II 3 G nA nC IIB T4 Gc X

Device type	TV500Ex, ST500Ex	TV501Ex	TV125M-Ex, ST125M-EX
<b>Brief description</b>	<i>Isolating Signal Converter</i>  <b>Signal input:</b> 0/4..20 mA; 0/2..10 V (intrinsically safe) <b>Output:</b> 0/4..20 mA, 0/2..10 V	<i>Isolating Signal Converter</i>  <b>Signal input:</b> 0/4..20 mA; 0/2..10 V <b>Output:</b> 0/4..20 mA, 0/2..10 V (intrinsically safe)	<i>Universal Isolating Amplifier TV125M / ST125M</i>  <b>Signal input:</b> 0/4..20 mA; 0/2..10 V (intrinsically safe) <b>Output:</b> 0/4..20 mA, 0/2..10 V <b>Auxiliary voltage:</b> 24V- or wide range power supply
<b>Ignition protection type</b>	Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“ Non-sparking end equipment „nA nC“ (when installed in suitable cabinet)
<b>Protection class</b>	Housing IP 30, optionally IP 20	Housing IP 30, optionally IP 20	IP20
<b>Equipment group</b>	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II	Gas or dust mixtures of Equipment group II
<b>Potentially explosive area</b>	for connection of sensors from Zones 0, 1, 2, 20, 21, 22	for connection of sensors from Zones 0, 1, 2, 20, 21, 22	for connection of sensors from Zones 0, 1, 2, 20, 21, 22

More information can be found in the product information or online on [www.ghm-messtechnik.de](http://www.ghm-messtechnik.de)



Ex II (1) G [Ex ia Ga] IIC / IIB  
 Ex II (1) D [Ex ia Da] IIC  
 Ex II 3G Ex nA nC IIB T4 Gc  
 Ex II 3G Ex nA nC [ic Gc] IIB T4 Gc



Ex II (1) G [Ex ia] IIC/IIB  
 Ex II (1) D [Ex iaD]



Ex II (1) G [Ex ia] IIC/IIB  
 Ex II (1) D [Ex iaD]



Ex II (1) G [Ex ia] IIC/IIB  
 Ex II (1) D [Ex iaD]

<b>TS125L-Ex, TS125M-Ex, TS225M-Ex</b>	<b>TS500-EX</b>	<b>MR50Ex</b>	<b>STL50Ex</b>
<p><b>Isolating switching amplifier</b></p> <p>1- or 2-channel functional safety to SIL2 mounting in Zone 2 possible 2,5 mm or 22,5 mm case width</p> <p><b>Measurement input:</b> (intrinsically safe) Switching contacts, Namur initiators, optocouplers</p> <p><b>Outputs:</b> Relay contact (transformer or transmitter)</p> <p><b>Auxiliary voltage:</b> 24V- or wide range power supply</p>	<p><b>Isolating switching amplifier</b></p> <p>1 or 2-channel</p> <p><b>Signal inputs:</b> (intrinsically safe) Switching contacts, Namur initiators, optocouplers</p> <p><b>Outputs:</b> Relay contact (transformer) or electronics (transistor)</p>	<p><b>Limit value switch</b></p> <p><b>Measurement input:</b> Standard signals 0/4..20 mA; 0/2..10 V</p> <p><b>Output:</b> 0/4 – 20 mA, 0/2 – 10 V DC galvanically isolated 2 alarm outputs</p>	<p><b>Safety temperature limiter according to DIN EN 14597</b></p> <p><b>Measurement input</b> PT100, 3-wire, -100 .. +600 °C  <b>Type J (Fe-CuNi)</b> -100 .. +800 °C  <b>Type K (NiCr-Ni)</b> -150 .. +1200 °C  <b>Type N (NiCrSi-NiSi)</b>  -150 .. +1200 °C  <b>Type S (Pt10Rh-Pt)</b>  0 .. 1600 °C  <b>Auxiliary voltage:</b>  230 V AC +/-10 %  115 V AC +/-10 %  24 V DC +/-15 %  <b>Working temperature:</b>  -10 .. 55 °C</p>
<p>Intrinsic safety „i“ Non-sparking end equipment „nA nC“ (when installed in suitable cabinet)</p>	<p>Intrinsic safety „i“</p>	<p>Intrinsic safety „i“</p>	<p>Intrinsic safety „i“</p>
<p>IP20</p>	<p>Housing IP 30, optionally IP 20</p>	<p>Housing IP 30, optionally IP 20</p>	<p>IP 20</p>
<p>Gas or dust mixtures of Equipment group II</p>	<p>Gas or dust mixtures of Equipment group II</p>	<p>Gas or dust mixtures of Equipment group II</p>	<p>Gas or dust mixtures of Equipment group II</p>
<p>for connection of sensors from Zones 0, 1, 2, 20, 21, 22</p>	<p>for connection of sensors from Zones 0, 1, 2, 20, 21, 22</p>	<p>for connection of sensors from Zones 0, 1, 2, 20, 21, 22</p>	<p>for connection of sensors from Zones 0, 1, 2, 20, 21, 22</p>



## D Laboratory Instrumentation Handheld Instruments



II 2 G Ex ib IIC T4 Gb

II 2 G Ex ib IIC T4 Gb

II 2 G Ex ib IIC T4 Gb

Device type	GMH 3111 - ex	GMH 3151 - ex	GMH 3156 - ex
<b>Brief description</b>	<p><i>Handheld pressure measuring device</i></p> <p><b>Number of connectible sensors:</b> 1  <b>Measurement range:</b> depending on the sensor used (see page 25)  <b>Output:</b> Interface  <b>Display:</b> 2 x 4 1/2 digit LCD</p>	<p><i>Handheld pressure measuring device with logger</i></p> <p><b>Number of connectible sensors:</b> 1  <b>Measurement range:</b> depending on the sensor used (see page 25)  <b>Output:</b> Interface or analogue output (0-1 V)  <b>Display:</b> 2 x 4 1/2 digit LCD</p>	<p><i>Handheld pressure measuring device with logger</i></p> <p><b>Number of connectible sensors:</b> 2  <b>Measurement range:</b> depending on the sensors used (see page 25)  <b>Output:</b> Interface or analogue output (0-1 V)  <b>Display:</b> 2 x 4 1/2 digit LCD</p>
<b>Ignition protection type</b>	Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“
<b>Protection class</b>	IP 65 for the device front	IP 65 for the device front	IP 65 for the device front
<b>Equipment group</b>	Gas mixtures of Equipment group II	Gas mixtures of Equipment group II	Gas mixtures of Equipment group II
<b>Potentially explosive area</b>	Zone 1, Zone 2	Zone 1, Zone 2	Zone 1, Zone 2



## D Laboratory Instrumentation Handheld Instruments, Pressure sensors



II 2 G Ex ib IIC T4 Gb

### GMSD ... - ex

**Piezo-resistive pressure sensor**

**Sensor for:**

GMH 3111, GMH 3151, GMH 3156

**Measurement range**

**(depending on sensor type):**

-1.999..+2.500 mbar rel. to

-1.00..+10.00 bar rel.

or 0..1300 mbar abs. to

0.00..7.00 bar abs.

**Pressure connection**

**(process connection):**

2 nylon connecting ports for hoses 6 x 1 mm (6 mm outside Ø and 4 mm inside Ø)

**Working temperature:** 0..50 °C



II 2 G Ex ib IIC T4

### MSD ... - ex

**Stainless steel pressure sensor**

**Sensor for:**

GMH 3111, GMH 3151, GMH 3156

**Measurement range**

**(depending on sensor type):**

0.0..100.0 mbar rel. to

0..1000 bar rel.

or 0..1000 mbar abs to

0.00..25.00 bar abs.

**Pressure connection**

**(process connection):**

connection thread G 1/2B

**Working temperature:**

-20..+80 °C



II 2 G Ex ib IIC T4 Gb

### GMH 3161 - ... - ex

**Handheld pressure measuring device**

**Number of connectible sensors:**

Integrated pressure sensor with 1 or 2 connections (absolute =1; relative =2)

**Number of connectible sensors:**

-1..+25 mbar to

-1000..+2000 mbar rel. and

0..1300 mbar abs.

**Output:**

Interface

**Display:**

2 x 4 1/2-digit LCD



II 2 G Ex ib IIC T4 Gb

### GMH 3181 - ... - ex

**Handheld pressure measuring device with logger**

**Number of connectible sensors:**

Integrated pressure sensor with 1 or 2 connections (absolute =1; relative =2)

**Measurement range (depending on device type):**

1..+25 mbar to -

1000..+2000 mbar rel.

and 0..1300 mbar abs.

**Output:**

Interface or analog output (0-1 V)

**Display:**

2 x 4 1/2-digit LCD


Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“	Intrinsic safety „i“
-	IP 67 for the sensor	IP 65 for the device front	IP 65 for the device front
Gas mixtures of Equipment group II	Gas mixtures of Equipment group II	Gas mixtures of Equipment group II	Gas mixtures of Equipment group II
Zone 1, Zone 2	Zone 1, Zone 2	Zone 1, Zone 2	Zone 1, Zone 2

# Your contact to us.



## Sales Center Export

 [info@ghm-group.de](mailto:info@ghm-group.de)

 +49 2191 9672-0

 +49 2191 9672-40



### Asia and India

- Subsidiary in Mumbai
- Numerous certified partners



### Europe

- 12 locations, including sales centers
- 5 production locations and specialized sales locations



### Americas

- Subsidiary in São Paulo
- Qualified partners



### Africa

- Subsidiary in Johannesburg
- Reliable partners



# Your ideas and requests are our inspiration.

## Challenge us.


The GHM Messtechnik GmbH Group was founded in 2009. However, the history of the traditional brands that are bundled under the umbrella brand goes back much further. In its current formation as the GHM GROUP, the enterprise is still obligated to the shared philosophy of the founders: Absolute customer orientation, speed, and first-class product quality!

**Innovation with method:** An increasing number of tasks in terms of the global economy and in technology reach the limits of feasibility and beyond. We meet this challenge with a broad-based enterprise structure

The Centers of Competence under the umbrella of the GHM GROUP cover a wide range of market-specific solutions for all important areas of application with their respective areas of expertise.

With the GHM GROUP our customers benefit from over 200 years of combined experience. With this expertise, our engineers at the various "Centers of Competence" are quickly and flexibly in a position to develop solutions that meet the specific requirements of our customers and are in-line with market demand.

**It is an advantage of our enterprise, which is unrivalled.**

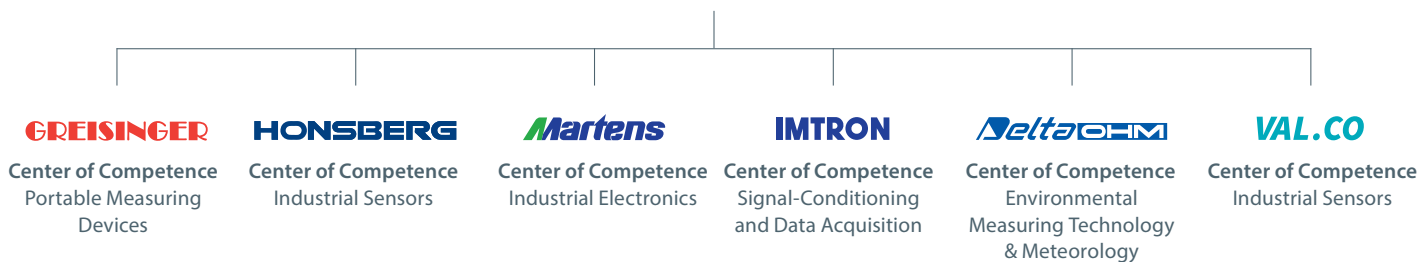

### INDUSTRIAL

- Sensors for a variety of process variables such as temperature, flow, level and pressure
- Transmitters and isolators for various input/ output variables
- Indicators and controllers in various formats and performance classes



### ENVIRONMENTAL

- Measuring stations for climate and environmental data with the connection to cloud-systems
- Mobile measurement technology for climate, water and gas analysis



### TESTING & SERVICES

- Test bench measurement technology with up to 40,000 measurement in the secondary
- Stationary and mobile systems for universal use
- Modular systems for individual adaption to the process needs



Your direct contact to us



**+49 2191 9672-0**



**info@ghm-group.de**

### Headquarters

GHM Messtechnik GmbH  
**GHM GROUP CORPORATE**  
Tenter Weg 2-8  
42897 Remscheid | GERMANY  
Phone +49 2191 9672-0  
Fax +49 2191 9672-40  
info@ghm-group.de  
www.ghm-group.de

### Center of Competence

GHM Messtechnik GmbH  
**GHM GROUP – Greisinger**  
Hans-Sachs-Straße 26  
93128 Regenstauf | GERMANY  
Phone +49 9402 9383-52  
Fax +49 9402 9383-33  
info@greisinger.de  
www.greisinger.de

GHM Messtechnik GmbH  
**GHM GROUP – Honsberg**  
Tenter Weg 2-8  
42897 Remscheid | GERMANY  
Phone +49 2191 9672-0  
Fax +49 2191 9672-40  
info@ghm-group.de  
www.ghm-group.de

GHM Messtechnik GmbH  
**GHM GROUP – Martens**  
Kiebitzhörn 18  
22885 Barsbüttel | GERMANY  
Phone +49 40 67073-0  
Fax +49 40 67073-288  
info@ghm-group.de  
www.ghm-group.de

GHM Messtechnik GmbH  
**GHM GROUP – Imtron**  
Carl-Benz-Straße 11  
88696 Owingen | GERMANY  
Phone +49 7551 9290-0  
Fax +49 7551 9290-90  
info@ghm-group.de  
www.ghm-group.de

Delta OHM S.r.l. a socio unico  
**GHM GROUP – Delta OHM**  
Via Marconi 5  
35030 Caselle di Selvazzano  
Padova (PD) | ITALY  
Phone +39 049 8977150  
info@deltaohm.com  
www.deltaohm.com

Valco srl  
**GHM GROUP – Val.co**  
Via Rovereto 9/11  
20014 S. Ilario di Nerviano  
Milano (MI) | ITALY  
Phone +39 0331 53 59 20  
valco@valco.it  
www.valco.it

### GHM GROUP International

#### Austria

GHM Messtechnik GmbH  
Office Austria  
Breitenseer Str. 76/1/36  
1140 Vienna | AUSTRIA  
Phone +43 660 7335603  
a.froestl@ghm-messtechnik.de  
www.ghm-group.de

#### Brazil & Latin America

GHM Messtechnik Do Brasil Ltda  
Av. José de Souza Campos,  
1073, cj 06 | Campinas, SP  
13025 320 | BRAZIL  
Phone +55 19 98275 0069  
info@grupoghm.com.br

#### Czech Republic / Slovakia

GHM Greisinger s.r.o.  
Ovci hajek 2 / 2153  
158 00 Prague 5  
Nove Butovice | CZECH REPUBLIC  
Phone +420 251 613828  
Fax +420 251 612607  
info@greisinger.cz  
www.greisinger.cz

#### Denmark

GHM Maaleteknik ApS  
Maarslet Byvej 2  
8320 Maarslet | DENMARK  
Phone +45 646492-00  
Fax +45 646492-01  
info@ghm.dk  
www.ghm.dk

#### France

GHM GROUP France SAS  
Parc des Pivollez  
9 Rue de Catalogne  
69150 Décines (Lyon) | FRANCE  
Phone +33 6 60 32 06 35  
contact@ghm-group.fr  
www.ghm-group.fr

#### India

GHM Messtechnik India Pvt Ltd.  
209 | Udyog Bhavan  
Sonowala Road | Gregaon ( E )  
Mumbai - 400 063 | INDIA  
Phone +91 22 40236235  
info@ghmgroup.in  
www.ghmgroup.in

#### Italy

Sales Greisinger & Delta OHM  
GHM GROUP – Delta OHM  
Via Marconi 5  
35030 Caselle di Selvazzano  
Padova (PD) | ITALY  
Phone +39 049 8977150  
info@deltaohm.com

#### Italy

Sales Honsberg, Martens, Valco  
GHM GROUP – Val.co  
Via Rovereto 9/11  
20014 S. Ilario di Nerviano  
Milano (MI) | ITALY  
Phone +39 0331 53 59 20  
alessandro.perego@valco.it

#### Netherlands

GHM Meettechnik BV  
Zeeltweg 30  
3755 KA Eemnes  
NETHERLANDS  
Phone +31 35 53805-40  
Fax +31 35 53805-41  
info@ghm-nl.com  
www.ghm-nl.com

#### South Africa

GHM Messtechnik SA (Pty) Ltd  
16 Olivier Street  
Verwoerdpark, Alberton 1453  
SOUTH AFRICA  
Phone +27 74 4590040  
j.grobler@ghm-sa.co.za



Visit us: [www.ghm-group.de](http://www.ghm-group.de)